
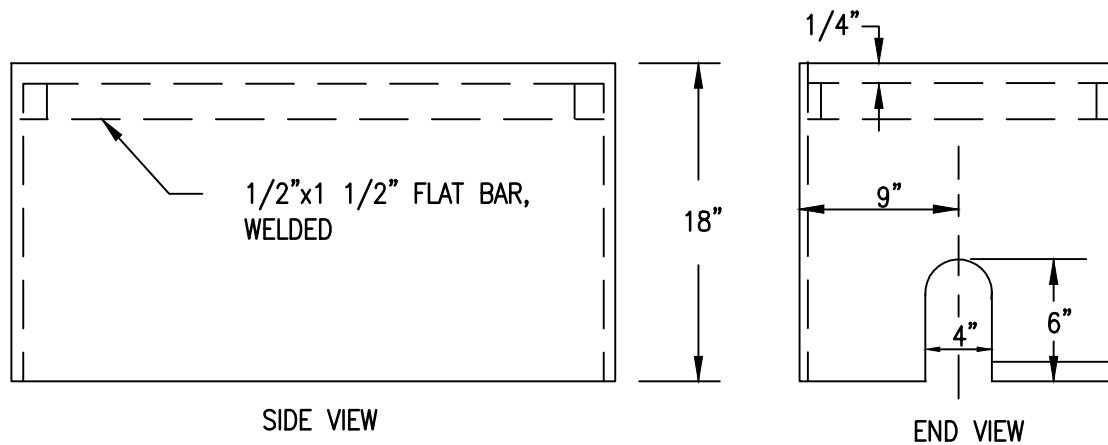


NOTE:

1. VAULT TO BE CONSTRUCTED OF 1/4" STD. SHEET STEEL.
2. ENTIRE VAULT & TOP TO BE COATED WITH 2 COATS RED LEAD PRIMER & 2 COATS RUST-OLEUM.

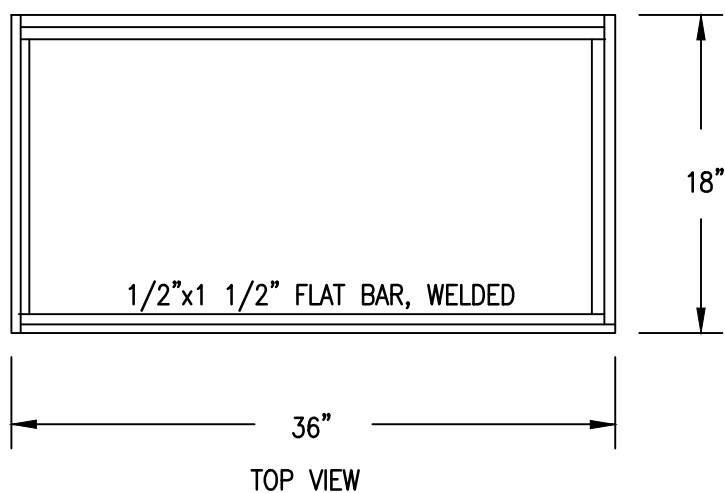

CITY OF NORFOLK – DEPARTMENT OF UTILITIES
STANDARD DETAILS

SCALE:
NOT TO SCALE

WATER METER VAULT & TOP

DRAWING NO.
CW 03

DATE: 03/07